



LEGEND	
NO.	DESCRIPTION
1	WATER MAIN
2	CORPORATION STOP & SERVICE SADDLE (IF NEEDED)
3	GOOSENECK (IF COPPER)
4	TYPE K SOFT COPPER OR HDPE: C901 PE477 DR9 CTS BLUE WITH STIFFNERS
5	TRACE WIRE COPPERHEAD BLUE INSULATION
6	BULLET PIT (PLASTIC) 22"x36"
7	METER SETTER
8	WATER METER
9	METER COVER
10	PVC STABILIZER
11	APPLICANT'S SERVICE LINE
12	PER INTERNATIONAL PLUMBING CODE CTS
13	TRANSITION COUPLING (IF NEEDED SEE NOTE 1)

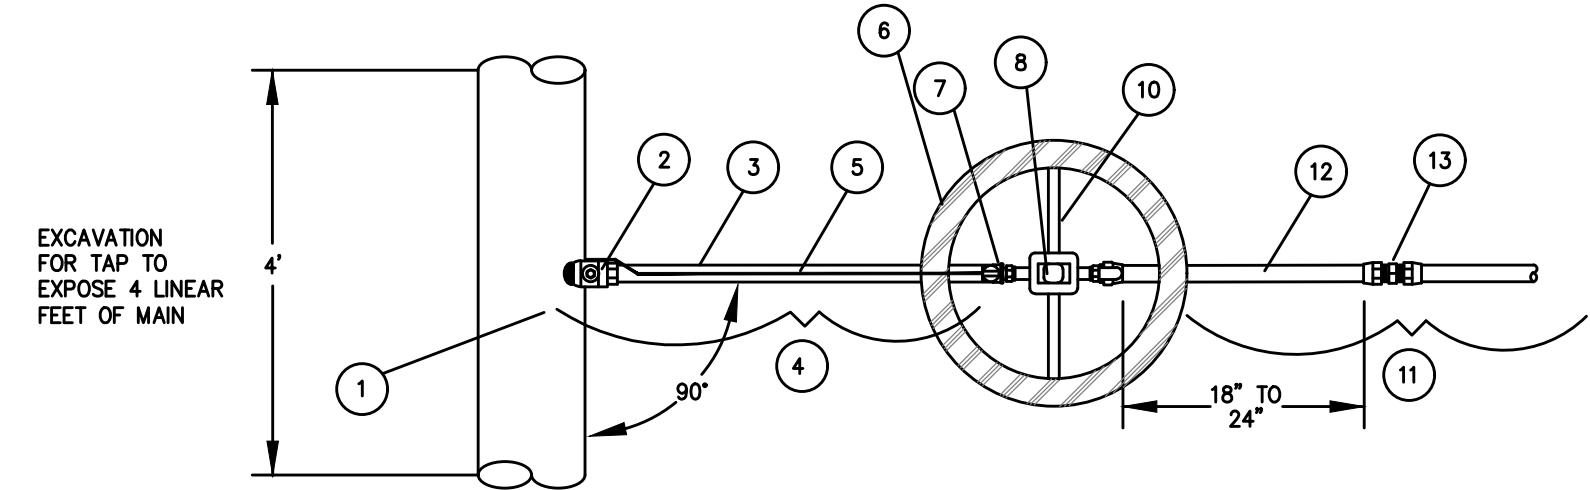

NOTES:

- A. EXCAVATIONS SHALL BE IN ACCORDANCE WITH OSHA REGULATION (STANDARD - 29 CFR) SUBPART 1926.650 THROUGH 1926.652 AND APPENDICES A THROUGH F.
- B. THIS METER PIT IS NOT TO BE LOCATED IN AREA SUBJECT TO VEHICULAR OR PEDESTRIAN TRAFFIC, OR IN CONCRETE PAVEMENT
- C. IF METER IS NOT LOCATED IN RIGHT OF WAY, APPROVAL MUST BE OBTAINED FROM WATERONE.
- D. IF METER SIZE VARIES FROM THE TAP SIZE, WATERONE WILL PROVIDE ADAPTERS.
- E. WATERONE TO FURNISH ITEMS 2, 5, 6, 7, 8 & 9.
- F. ALL EXCAVATION AND INSTALLATION TO BE COMPLETED BY CONTRACTOR.
- G. UNDER NO CIRCUMSTANCE SHALL OTHER EQUIPMENT OF ANY DESCRIPTION BE INSTALLED IN THIS PIT.
- H. SETTER SHALL BE CENTERED IN PIT.
- I. DO NOT COVER COUPLINGS IN PIT.
- J. SEE SERVICE APPLICATION BOOKLET FOR DEFINITIONS, RESPONSIBILITY OF APPLICANT AND GENERAL SPECIFICATIONS.
- K. ALL REQUIREMENTS AND SPECIFICATIONS ARE SUBJECT TO CHANGE WITHOUT NOTIFICATION.
- L. IF CUSTOMER SERVICE LINE IS PE OR PEX, THE TRANSITION COUPLING IS NOT NEEDED.
IF CUSTOMER SERVICE LINE IS METALLIC, THEN A TRANSITION FITTING SHALL BE USED AND PE WILL BE INSTALLED WITH STIFFNERS.

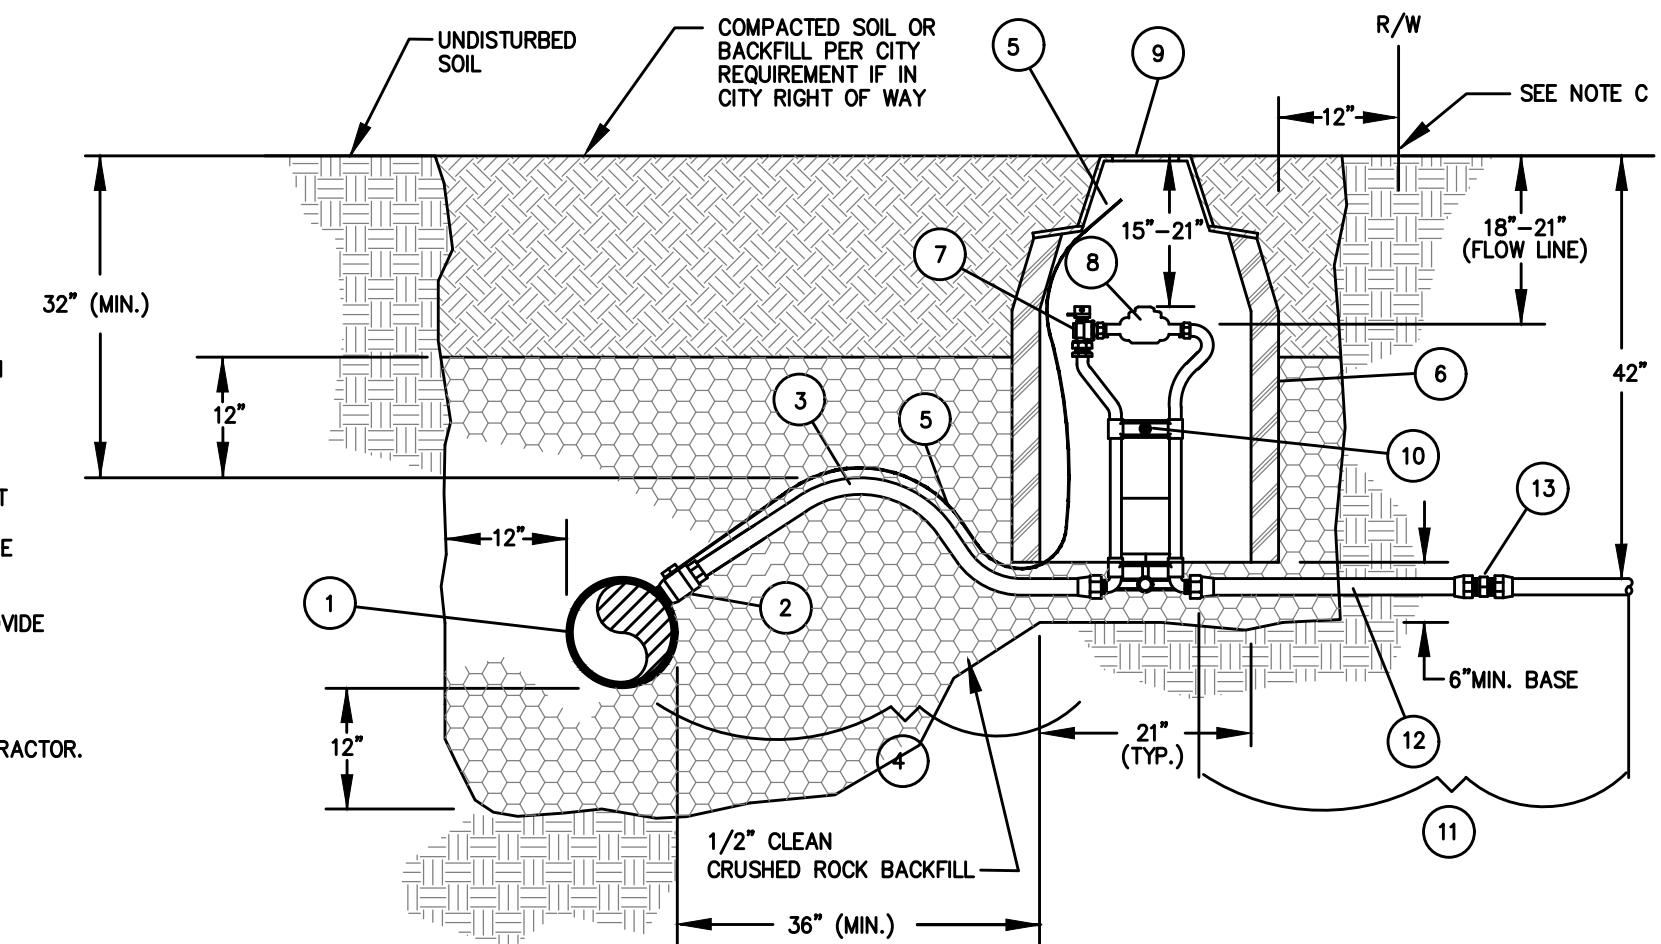

MANAGER OF DISTRIBUTION ENGINEERING	
INITIALS:	DATE:
MANAGER OF DISTRIBUTION WATER QUALITY	
INITIALS:	DATE:
MANAGER OF CONSTRUCTION MAINTENANCE VALVING & SERVICE	
INITIALS:	DATE:
DIRECTOR OF DISTRIBUTION	
INITIALS:	DATE:

WaterOne

" SERVICE CONNECTION 5/8", 3/4", 1" METER

STANDARD INSTALLATION

AWN BY: WRY/CAHM
TE: 05-20-2009⁴
TE UPDATED: 09-21-2017

DWG NO. ES-1823 (1")